




Operating, Maintenance and Control System For Sunny Repeaters – White Paper

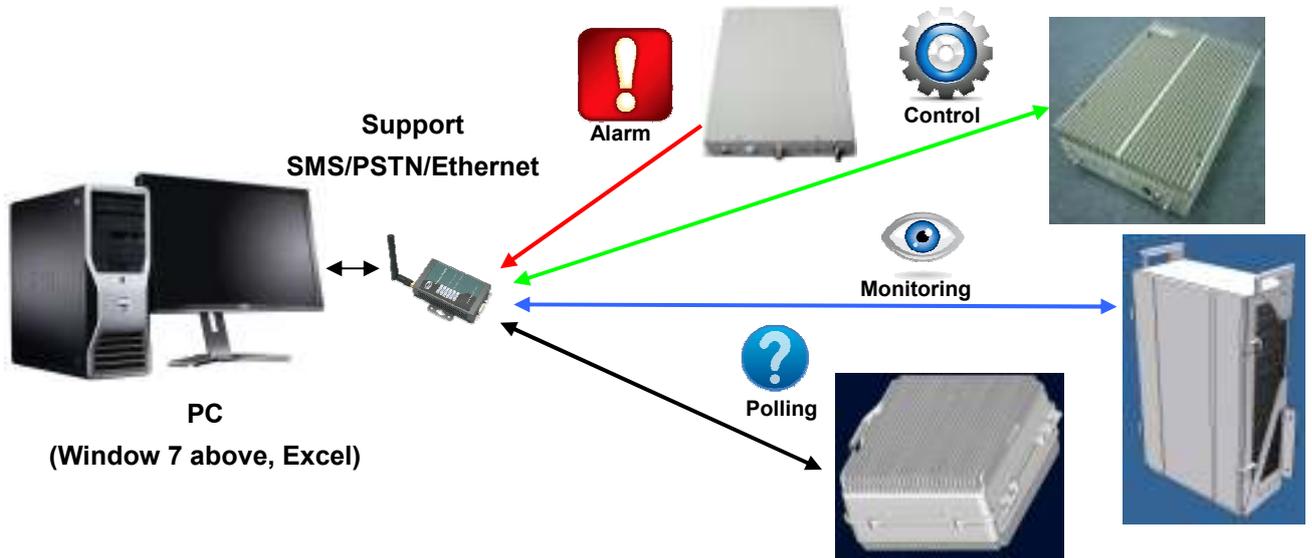

2000pcs max

Date	Time	Area	Repeater ID	Description	Event
9-4-2013	19:20:01	1	00001	ABCDE-FGHUK	AC Power OFF
9-4-2013	23:18:47	Hong Kong	00002	FGHIJKL	Temperature Alarm
10-4-2013	14:25:32	Kowloon	1234567	QWERTYUIO	AC Power OFF

User friendly GUI design for operation and maintenance purpose

Date	Time	Repeater ID	Area	Model	Description	Alarm	Polling	Event
20/03/13	14:00:54	00001	1	AKJ100-4	ABCDE-FGHUJ		Pass	
20/03/13	14:07:50	00002	Hong Kong	AKJ100-2	FGHIJ-KLMNO		Pass	
20/03/13	18:25:00	00001	1	AKJ100-4	ABCDE-FGHUJ	AC Power OFF Alarm		
20/03/13	10:03:10	00001	1	AKJ100-4	ABCDE-FGHUJ	AC Power OFF Alarm - Clearing		
20/03/13	11:07:50	00002	Hong Kong	AKJ100-2	FGHIJ-KLMNO			Clearing status changed for "Alarm"

Reporting